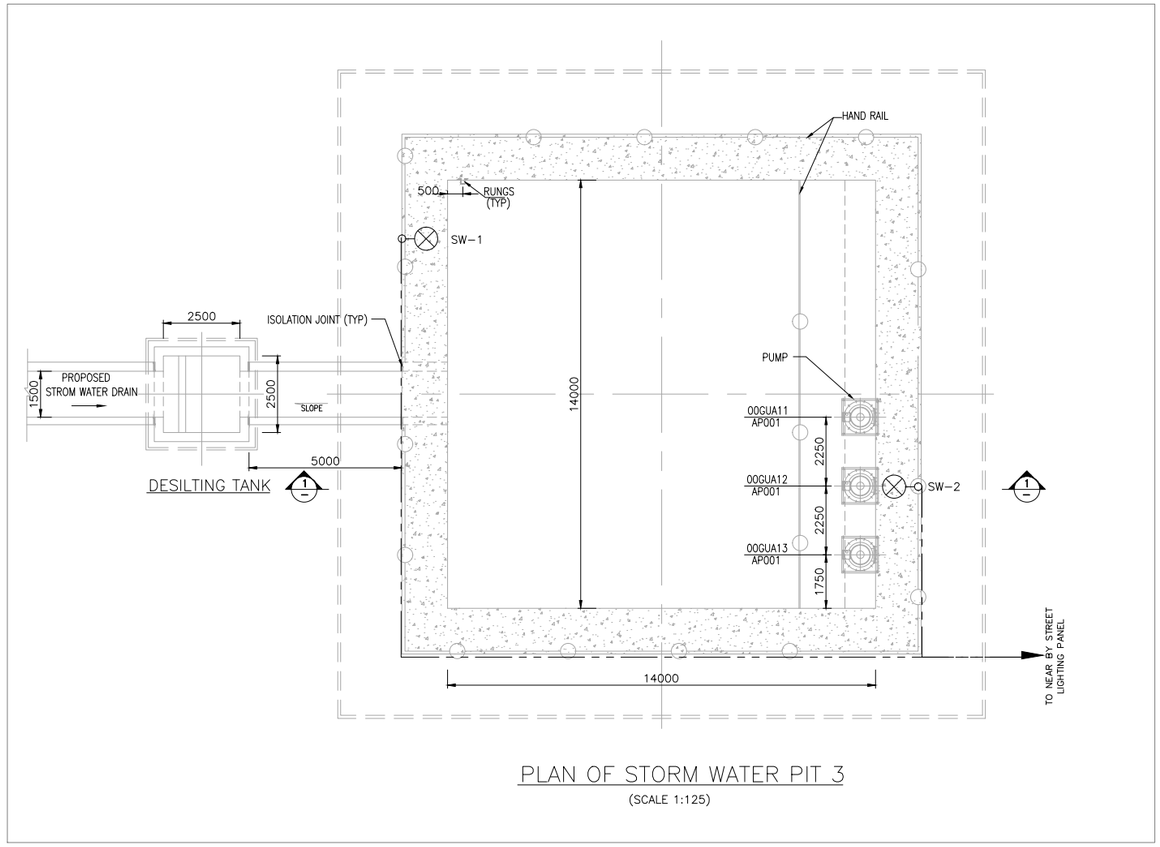

PLAN OF STORM WATER PIT 3

(SCALE 1:125)

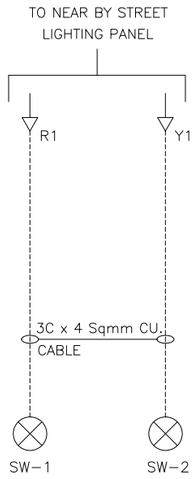

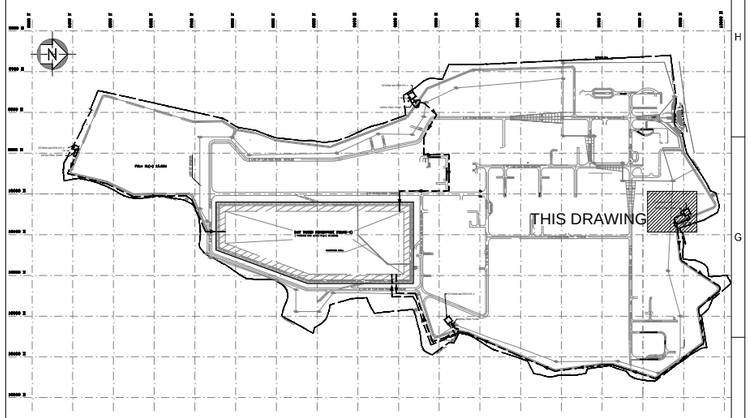

KEYPLAN:

BILL OF MATERIALS:-

S.No.	SYMBOL	TYPE	DESCRIPTION	QNTY.
01	⊗	SW1	70W HPSV AC NORMAL WELL GLASS LUMINAIRE (CGL – SWV1207/EQUIVALENT)	02 Nos.
02	–	–	3Cx4 Sq.mm. Cu. ARMOURED CABLE	45M
03	–	–	40NB 'B' CLASS PIPE	02 Nos.
04	–	–	150WX200HX6 THK. GALVANISED M.S.PLATE	02 Nos.
05	–	–	8MM DIA. 'U' BOLT	04 Nos.

NOTES:

01. ALL DIMENSIONS ARE IN MILLIMETRES AND LEVELS ARE IN METRES.
02. CABLE ROUTING SHOWN IS ONLY INDICATIVE. THE ACTUAL CABLE ROUTING SHALL BE DONE AS PER SITE CONDITION.
03. LP AND FIXTURE CIRCUIT NUMBERING SHALL BE READ AS FOLLOWS

REFERENCE DRAWINGS:-

01. PE-DG-319-100-M001 – PLOT PLAN

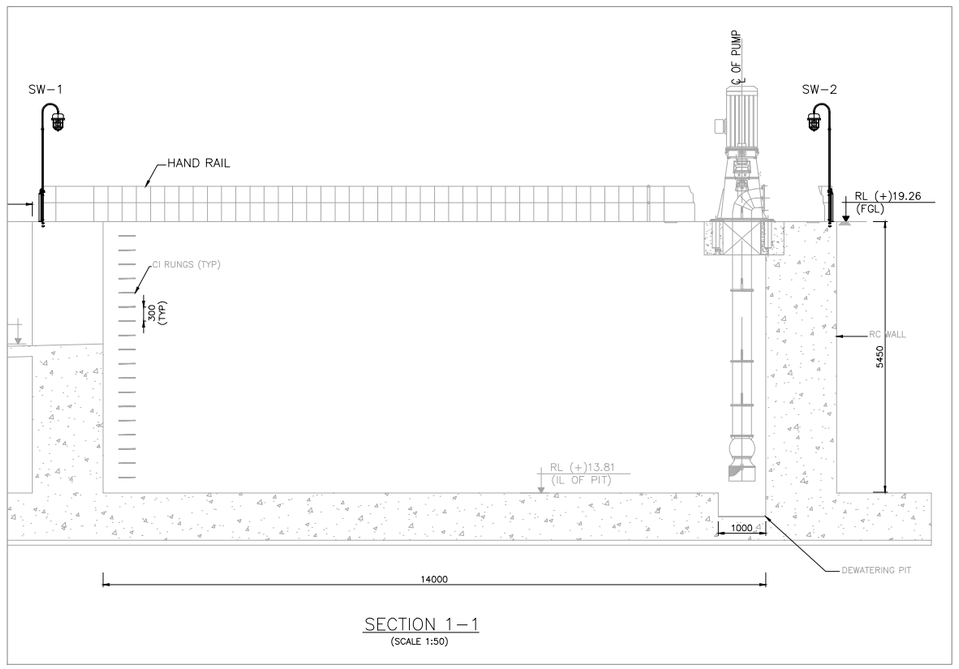

SECTION 1-1

(SCALE 1:50)

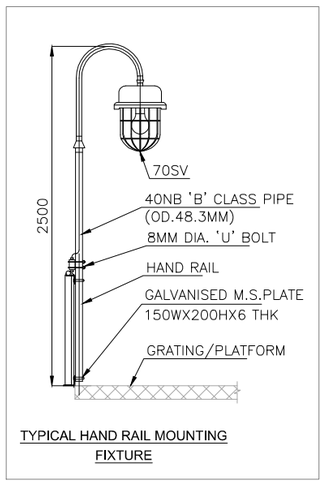

TYPICAL HAND RAIL MOUNTING FIXTURE

REV.	DATE	DESCRIPTION	DRN.	STR.	MECH.	ELEC.	INST.
R0	27.12.13	FOR APPROVAL	KR			DJS	
				APPROVED BY			

FICHTNER
Consulting Engineers (India) Private Limited
Chennai

ONGC TRIPURA POWER COMPANY PRIVATE LIMITED.
726.6 MW COMBINED CYCLE POWER PROJECT
PALLATANA, TRIPURA

	SIGNATURE	DATE
DRAWN	KR	27.12.13
DESIGNED	RSV	27.12.13
CHECKED	RSV	27.12.13
DEPT.HEAD	DJS	27.12.13
PROJ.MGR.	DKS/RUV	27.12.13

TITLE

STORM WATER PIT -3
LIGHTING LAYOUT

RELEASED FOR: PRELIMINARY | TENDER ✓ | ENGINEERING

DEPT. ELECT. | JOB NO. 1113112 | SCALE: 1:125 | REV.

DWG.NO. 30-1113112-E-002 | R0

SHEET : 03 OF 04 | SIZE-A3